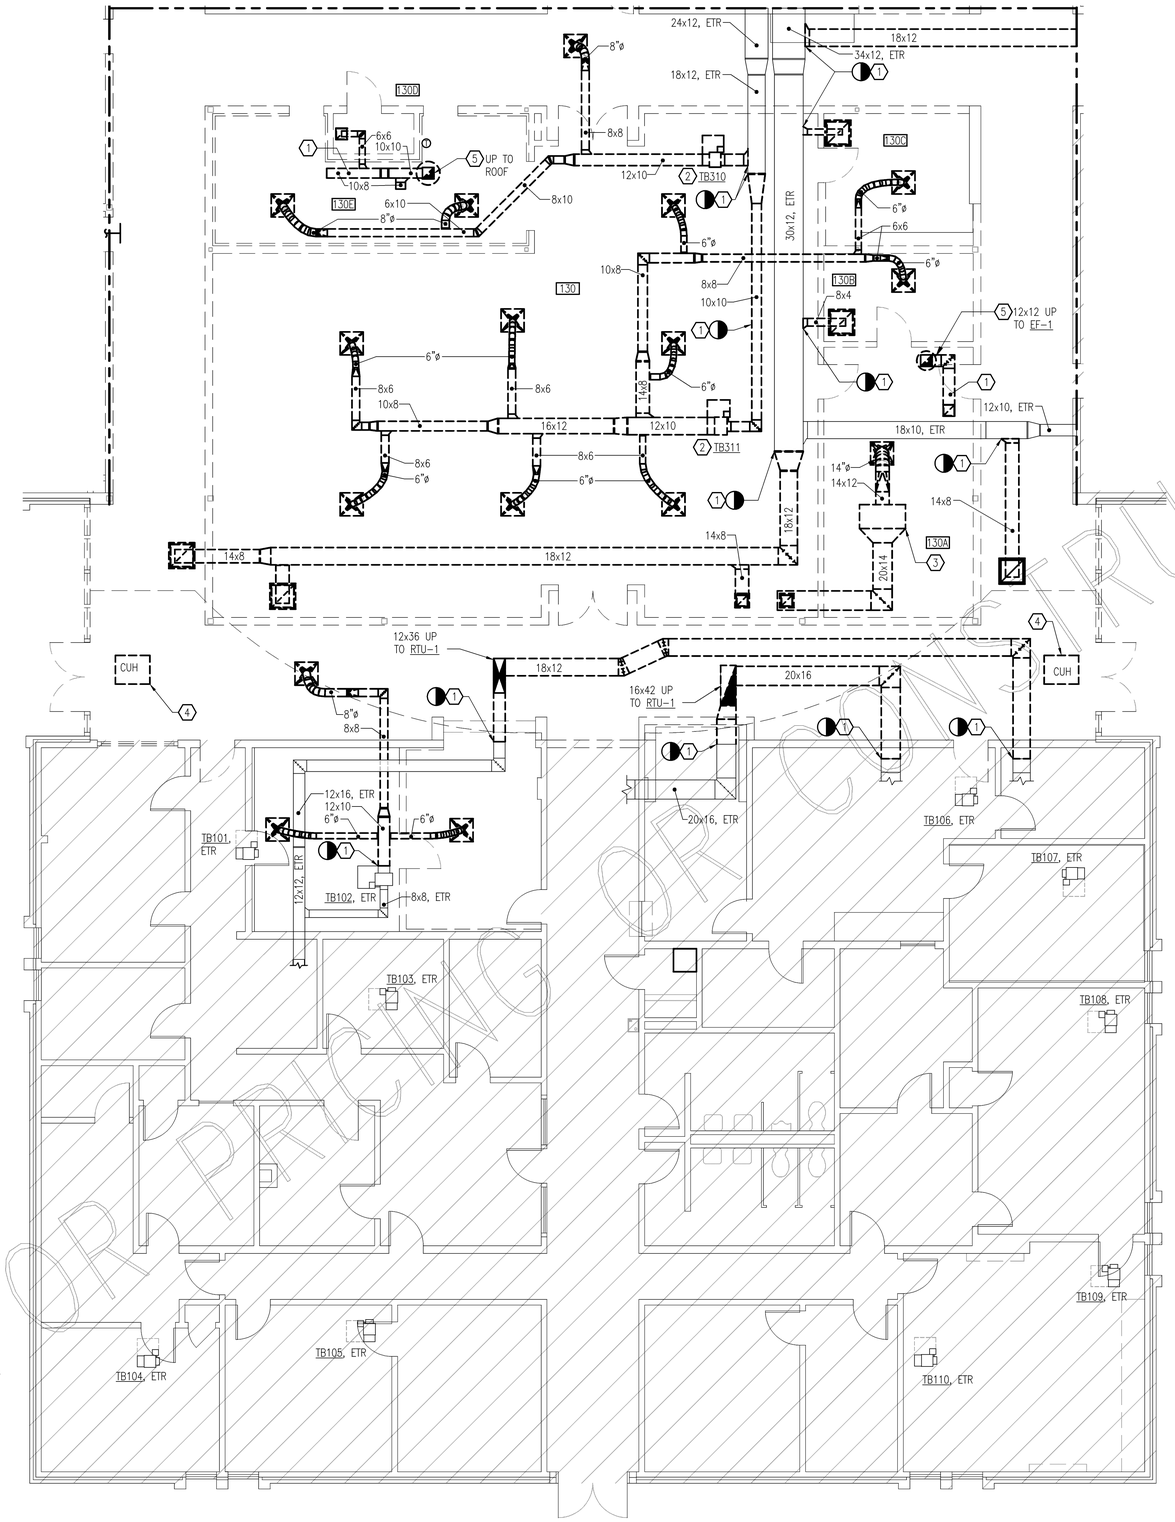

DEMOLITION FLOOR PLAN – MECHANICAL DUCTWORK
SCALE: 3/16" = 1'-0"

DEMOLITION NOTES THIS SHEET

1. REMOVE DUCTWORK, GRILLES AND DIFFUSERS, INSULATION HANGERS AND SUPPORTS COMPLETE TO POINT INDICATED. PROVIDE AIRTIGHT CAPS WHERE DUCT IS NOT BEING RECONNECTED.
2. REMOVE HIGH-PRESSURE VARIABLE VOLUME BOX AND ASSOCIATED PNEUMATIC THERMOSTAT AND TUBING. SEE NEW WORK ON DRAWING M1.6G. TEMPORARILY CAP CONTROL AIR SOURCE.
3. REMOVE FAN COIL UNIT, HANGERS AND SUPPORTS.
4. REMOVE CEILING MOUNTED UNIT HEATER, HANGERS, AND SUPPORTS COMPLETE.
5. REMOVE ROOFTOP EXHAUST FAN AND DUCTWORK COMPLETE. PROVIDE INSULATED SHEET METAL CAP OVER ROOF CURB. CROSS BREAK TO PREVENT OIL PANNING.

ASBESTOS AND LEAD PAINT NOTE

AN ASBESTOS INSPECTION WAS PERFORMED AND ASBESTOS CONTAINING MATERIALS WERE FOUND GENERALLY IN THE AREAS INDICATED IN THE ASBESTOS SURVEY/INSPECTION REPORT WHICH IS AVAILABLE TO THE CONTRACTOR(S) FOR HIS INFORMATION. ASBESTOS CONTAINING MATERIALS HAVE BEEN REMOVED UNDER A SEPARATE CONTRACT.

A LEAD-BASED PAINT INSPECTION WAS PERFORMED AND LEAD-BASED PAINT WAS FOUND IN THE AREAS INDICATED. THE CONTRACTOR SHALL BE RESPONSIBLE WITH ALL REQUIREMENTS OF THE VIRGINIA OCCUPATIONAL SAFETY AND HEALTH ADMINISTRATION REGULATIONS LEAD-BASED PAINT PROTECTION OF WORKERS.

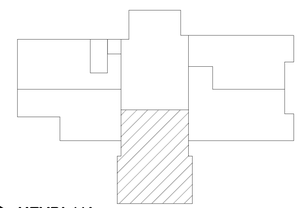

KEYPLAN
NO SCALE

GRAPHIC SCALES
3/16" = 1'-0" 0' 5' 10' 20'

NOT FOR PRICING

nbj ARCHITECTURE
A Professional Limited Company
GROVE PARK SQUARE
11537-B NUCKOLS ROAD
Richmond, Virginia 23059
(804) 273-9811 fax: (804) 273-9843

RAPPAHANNOCK COMMUNITY COLLEGE
CAMPUS RENOVATIONS
WARSAW + GLENNS, VIRGINIA
PC: 260-17712

GLENNS CAMPUS DEMOLITION FLOOR PLAN - MECHANICAL DUCTWORK

Date: JANUARY 13, 2010

REVISIONS

NO.	DATE

Pace COLLABORATIVE
MECHANICAL ELECTRICAL ENGINEERS
VIRGINIA BEACH, VA • 757-499-7220

COMMONWEALTH OF VIRGINIA
JOHN M. NEWELL
Lic. No. 035329
01.13.10
PROFESSIONAL ENGINEER

Sheet
MD1.6G

File Number
XX